Circuit Breaker for Equipment thermal, Snap-in type, Reset type, Quick connect terminals



## Description

- Snap-in version
- Thermal circuit breaker
- 1-pole
- Reset type
- Quick connect terminals 2.8 x 0.8 mm

#### **Unique Selling Proposition**

- Compact design
- Positively trip-free release
- Available with cover
- Different mounting possibilities

#### **Technical Data**

Toorninoar Bata	
Rated Voltage AC	AC 240 VAC
Rated Voltage DC	48 VDC
Rated current range AC	0.05 - 16 A
Conditional short circuit capa- city Inc	IEC 60934: PC1, AC 240 V: 2 kA
Short circuit capacity Icn	IEC 60934: at ln < 6.5 A/240 VAC : 8 _x ln
	IEC 60934: at ln ≥ 6.5 A/240 VAC : 96 A
Degree of Protection	front side IP40 acc. to IEC 60529
Dielectric Strength	50 Hz: > 1.5 kV
	Impulse 1.2/50 µs: > 2.5 kV
Insulation Resistance	$500 \text{ VDC} > 100 \text{ M}\Omega$
Endurance typical	2 x lr: 500 switching cycles
Endurance minimum	Reset type
	AC : 2 x lr , cos φ 0.6 :
	DC : 2 x lr , L/R = 2 - 3 ms :
	50 switching cycles

Overload	IEC: min. 40 trips
	@ 6 x lr, cos φ 0.6
	UL / CSA: min. 50 trips
	@ 1.5 x lr, cos φ 0.75
Allowable Operation Temp.	-5 °C to 60 °C
Vibration Resistance	± 1.5 mm @ 10 - 60 Hz
	acc. to IEC 60068-2-6, test Fc
	5 G @ 60 - 500 Hz
	acc. to IEC 60068-2-6, test Fc
Shock Resistance	100 G / 6ms
	acc. to IEC 60068-2-27, test Ea
Tripping Type	Thermal
Actuation Type	Reset type
Weight	ca. 10g

#### **Approvals and Compliances**

Detailed information on product approvals, code requirements, usage instructions and detailed test conditions can be looked up in Details about Approvals

SCHURTER products are designed for use in industrial environments. They have approvals from independent testing bodies according to national and international standards. Products with specific characteristics and requirements such as required in the automotive sector according to IATF 16949, medical technology according to ISO 13485 or in the aerospace industry can be offered exclusively with customer-specific, individual agreements by SCHURTER.

# ApplicationsPower toolsHousehold EquipmentPower supplies and chargers

- Industrial appliances

**Approvals and Compliances** 

#### Weblinks

See below:

pdf data sheet, html datasheet, General Product Information, Distributor-Stock-Check, Detailed request for product, Product News

# T11-614

## Approvals

The approval mark is used by the testing authorities to certify compliance with the safety requirements placed on electronic products. Approval Reference Type: T11

Approval Logo	Certificates	Certification Body	Description
	VDE Approvals	VDE	VDE Certificate Number: 99759
c <b>RL</b> us	UL Approvals	UL	UR File Number: E71572
	CCC Approvals	CCC	CCC Certificate Number: 2024010307710413

## **Product standards**

Product standards that are referenced

Design	Standard	Description
Designed according to	IEC 60934	Circuit-breakers for equipment (CBE)
Designed according to	UL 1077	Standard for Supplementary Protectors for Use in Electrical Equipment
Designed according to	CSA C22.2 No. 235	Supplementary Protectors
Designed according to	GB 17701	Circuit-breaker for equipment
	Designed according to Designed according to Designed according to	DesignStandardDesigned according toIEC 60934Designed according toUL 1077Designed according toCSA C22.2 No. 235

## **Application standards**

Application standards where the product can be used


Organization	Design	Standard	Description
I <u>EC</u>	Suitable for applications acc.	IEC/UL 62368-1	Audio/video, information and communication technology equipment - Part 1: Safety requirements


## Compliances


The product complies with following Guide Lines

Identification	Details	Initiator	Description
CE	CE declaration of conformity	SCHURTER AG	The CE marking declares that the product complies with the applicable requirements laid down in the harmonisation of Community legislation on its affixing in accordance with EU Regulation 765/2008.
UK CA	UKCA declaration of conformity	SCHURTER AG	The UKCA marking declares that the product complies with the applicable requirements laid down in the British Amendment of Regulation (EC) 765/2008.
COMPLIANT	RoHS	SCHURTER AG	Directive RoHS 2011/65/EU, Amendment (EU) 2015/863
	China RoHS	SCHURTER AG	The law SJ / T 11363-2006 (China RoHS) has been in force since 1 March 2007. It is similar to the EU directive RoHS.
REACH	REACH	SCHURTER AG	On 1 June 2007, Regulation (EC) No 1907/2006 on the Registration, Evaluation, Authorization and Restriction of Chemicals 1 (abbreviated as "REACH") entered into force.

Dimension [mm] T11-614N

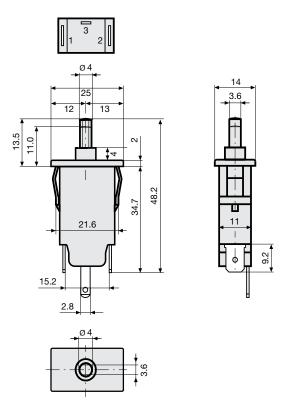



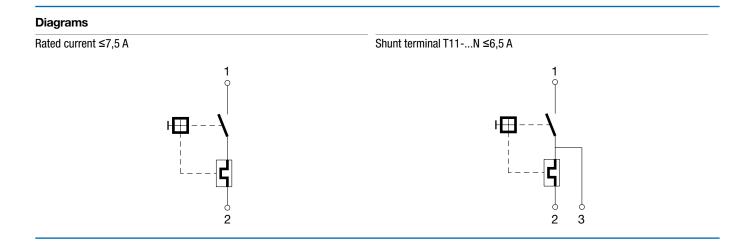

# T11-614

## Typical internal resistance per pole

Rated Current [A]	Internal Resistance [ $\Omega$ ]
0.05	380.000
0.50	5.200
1.00	1.350
2.00	0.300
3.00	0.130
4.00	0.080
5.00	0.040
6.00	0.040
7.00	0.020
8.00	0.012
9.00	0.012
10.00	0.011
11.00	0.0095
12.00	0.0095
13.00	0.0085
14.00	0.0085
15.00	0.0075
16.00	0.0075


#### Effect of ambient temperature

The units are calibrated for an ambient temperature of +23°C. To determine the rated current for a lower or higher ambient temperature, use a correction factor (typical value) from the table below:

Ambient Temperature [°C]	Correction factor
-5	0.87
0	0.90
+10	0.95
+23	1.00
+30	1.04
+40	1.10
+50	1.15
+60	1.20

Example: Rated current = 5 A, Environmental temperature = 40 °C, --> Correction factor = 1.1, Resulting current = 5.5 A --> Round to next higher rated current: 6 A

#### **Time-Current-Curves**

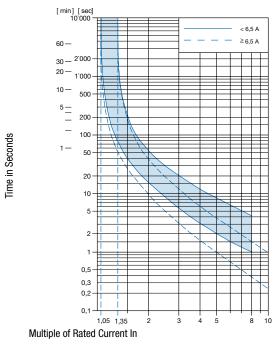

Ambient temperature +23°

# Config. Code

#### T11 - 1 2 3 A B - 1.23

The characters are placeholders for the correspondingly keys of selections from the key tables.

# T11 - **1** 2 3 A B - 1.23 = Mounting

Mounting	Configuration key
Snap-in mounting from front side	6
T11 - 1 <b>2</b> 3 A B - 1.23 = Actuation Type	
Actuation Type	Configuration key
Reset type	1
T11 - 1 2 <b>3</b> A B - 1.23 <b>= Terminal</b>	
Terminal	Configuration key
Quick connect terminals 2.8x0.8mm	4

# T11 - 1 2 3 A B - 1.23 = Shunt terminal

Shunt terminal	Configuration key
Shunt terminal	Ν
T11 - 1 2 3 A <b>B</b> - 1.23 <b>= Setting indication</b>	
Setting indication	Configuration key
Setting indication Setting indication	•

Rated current	Configuration key
Other rated currents on request	

#### Variants

Rated current	Construction variants		Config. Code	Order Number
	Shunt terminal	Setting indication		
1.0			-	4400.0414
2.0 A			-	4400.0045
6.0			-	4400.0643

Availability for all products can be searched real-time: https://www.schurter.com/en/info-center/ support-tools/stock-check-distributors **Packaging Unit** 

100 Pcs